



VAULT MANHOLE COVER

NOTES THIS DETAIL:


1. ALL LETTERING & ARTWORK SHALL BE FLUSH WITH FRAME RIM/LIP MOLDED INTO THE TOP OF THE COVER.
2. FRAME SHALL BE GRAY IRON CONFORMING TO A.S.T.M. A48-90, GRADE 30. COVER SHALL BE DUCTILE IRON CONFORMING TO A.S.T.M. A536-84, CLASS 80-50-06.
3. FIT TOLERANCES SHALL BE  $< 1/8" \pm$ .
4. WELDED FRAME AND COVERS ARE NOT ACCEPTABLE.

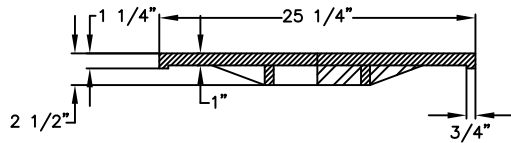


SECTION VIEW

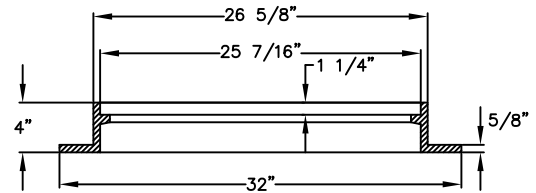

SECTION VIEW

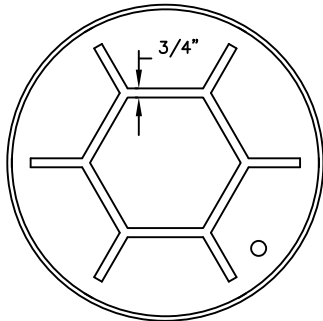

BOTTOM OF COVER

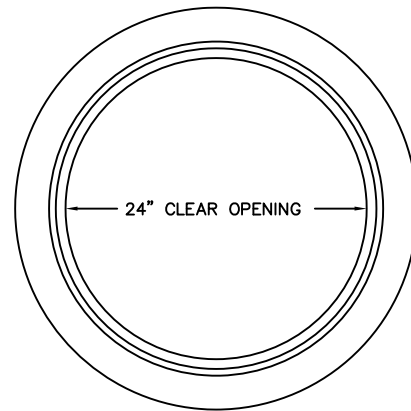

FRAME



CITY OF COEUR D'ALENE STANDARD DRAWING

**24" MANHOLE COVER  
FOR METER VAULT**

APPROVED BY:

*Chris Bosley*  
CITY ENGINEER, PE 10804

10/1/24  
DATE:

DWG NO.

W-30