


AIR GAP - MINIMUM OF TWICE
THE INLET PIPE DIAMETER
ABOVE THE FLOOD RIM BUT
NEVER LESS THAN 1 INCH.

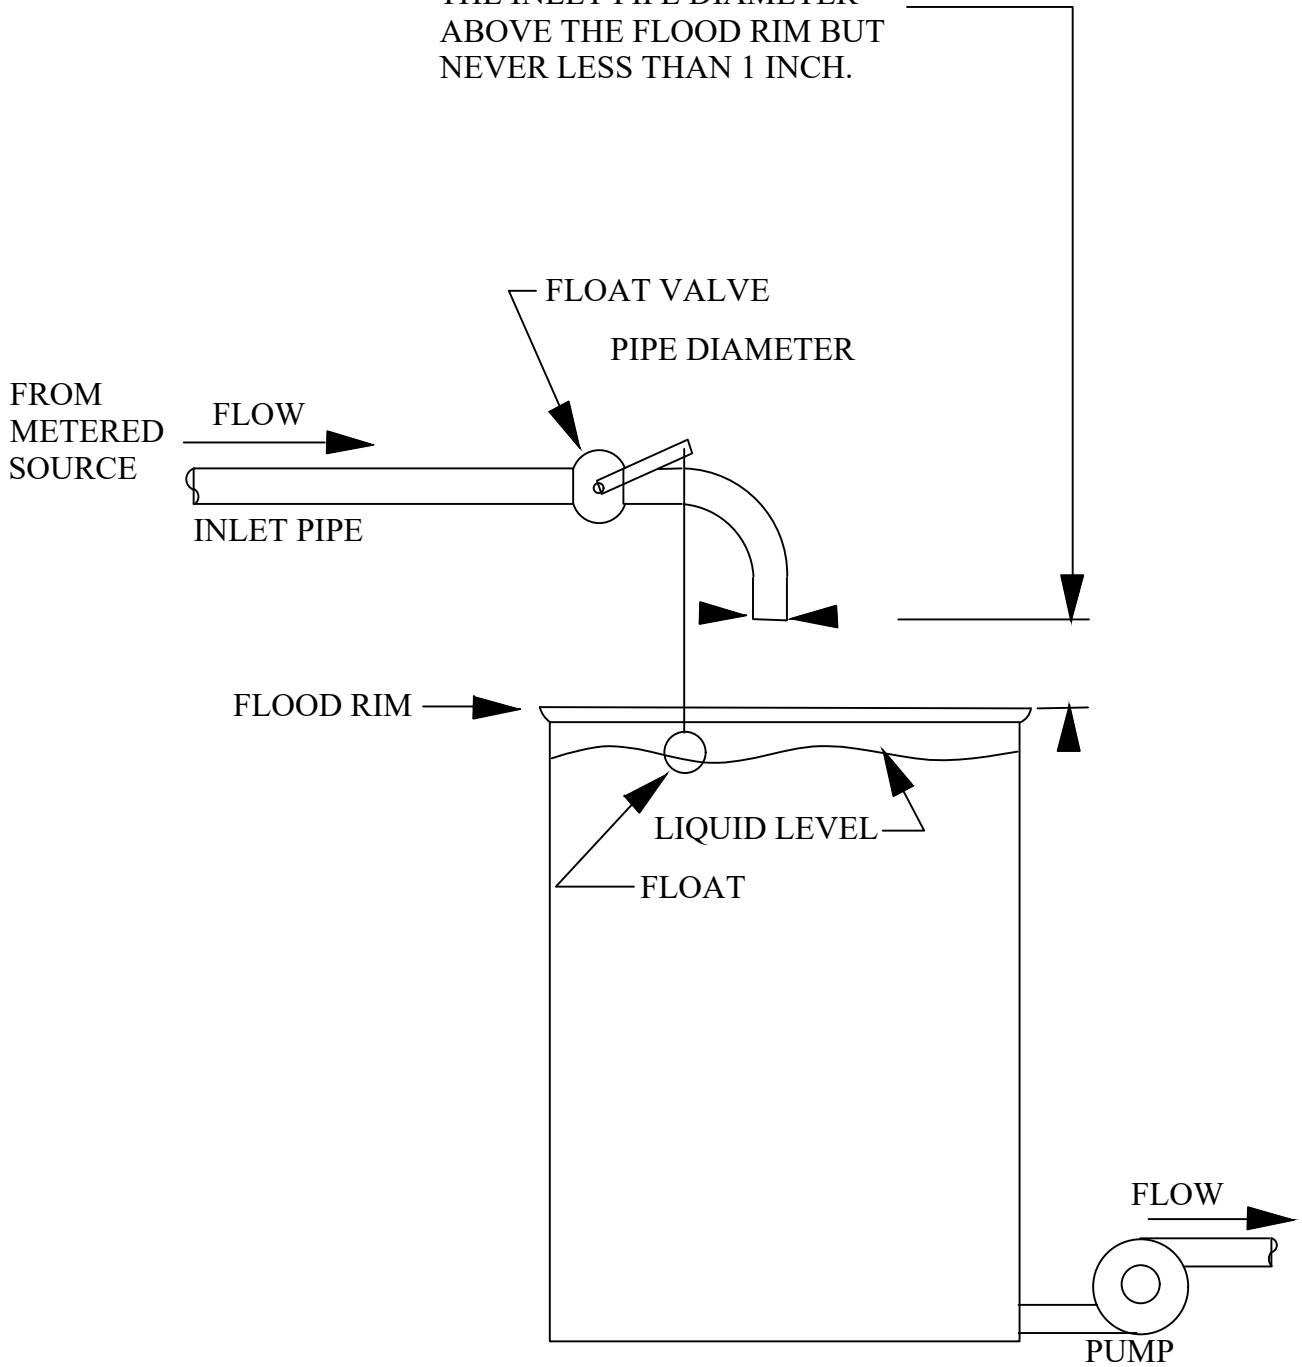

CITY OF COEUR D'ALENE STANDARD DRAWING

APPROVED BY:

APPROVED AIR GAP

Chris Bosley
CITY ENGINEER, PE 10804

10/1/24
DATE:

DWG NO.

W-27